



breglobal

**Classification report for
roofs/roof coverings
exposed to external fire
in accordance with BS
EN 13501-5: 2005**


Prepared for:
Recticel Limited
Enterprise Way
Meir Park
Stoke on Trent
Staffordshire
ST3 7TU

10th July 2009

Classification report no. 253813
issue 2



0578

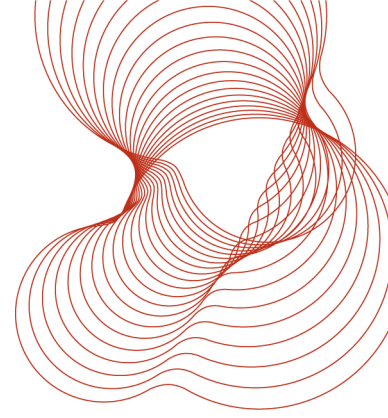

Prepared on behalf of BRE Global by

Name S M Warbus

Position Senior Consultant

Signature 

Approved on behalf of BRE Global by

Name S J Howard

Position Principal Consultant

Date 10/07/2009

Signature 

BRE Global
Bucknalls Lane
Watford
Herts
WD25 9XX
T + 44 (0) 1923 664100
F + 44 (0) 1923 664994
E enquiries@breglobal.com
www.breglobal.com


BRE Global is not UKAS accredited to make opinions and interpretation. Any opinions and interpretations included as part of this report are clearly marked as such.



0578

This report may only be distributed in its entirety and in accordance with the terms and conditions of the contract. Test results relate only to the items tested. We have no responsibility for the design, materials, workmanship or performance of the product or items tested. This report does not constitute an approval, certification or endorsement of the product tested.

This report is made on behalf of BRE Global. By receiving the report and action on it, the client accepts that no individual is personally liable in contract, tort or breach of statutory duty (including negligence). No third party has any right to rely on this report.

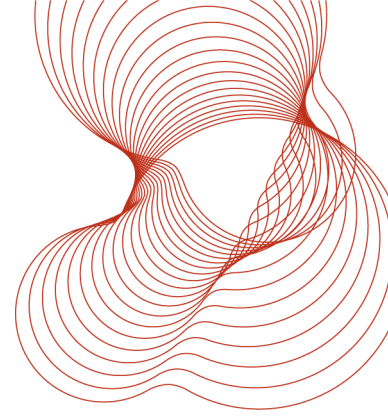

CLASSIFICATION REPORT FOR ROOFS/ROOF COVERINGS EXPOSED TO EXTERNAL FIRE

Sponsor: Recticel Limited
Enterprise Way, Meir Park, Stoke on Trent, Staffordshire, ST3 7TU

Prepared by: BRE Global, BRE, Bucknalls Lane, Garston, Watford, WD25 9XX, England

Notified Body No: 1576


Product name: Fatrafol 810 membrane over 120mm Recticel Eurothane Silver on a plywood base

Classification report No.: 253813

Issue number: 2

Date of issue: 10th July 2009

This classification report consists of six pages and may only be used or reproduced in its entirety

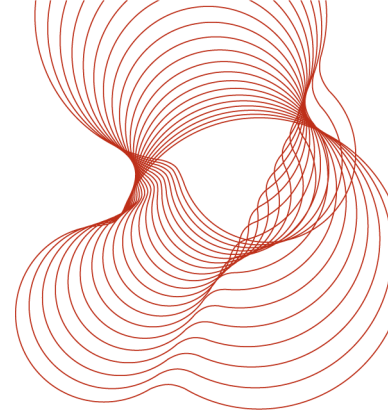

1 Introduction

This classification report defines the classification assigned to Fatrafol 810 membrane over 120mm Recticel Eurothane Silver on a plywood base in accordance with the procedures given in EN 13501-5:2005.

2 Product description

The roof comprises: Fatrafol 810 membrane over 120mm Recticel Eurothane Silver on a plywood base.

Full product description as provided by the client is as follows.

18mm Plywood Base

Polythene Vapour Control Layer (Loose laid)

120mm Recticel Eurothane Silver

Insulation mechanically fixed in centre with tube fixing and membrane fixing discs. (Note: Fixings were used in the corners of samples to retain the insulation during testing)

Fatrafol 810 membrane was adhesively bonded to the membrane fixing disc with Fatra membrane adhesive.

3 Test reports/extended application reports & test results in support of classification

<i>Name of Laboratory</i>	<i>Name of sponsor</i>	<i>Test report ref. no.</i>	<i>Test method</i>
BRE Global	Recticel Limited	253812 revision 1	ENV 1187:2002 Test 4

4 Test results

Test conditions:

Test pitch: Flat
 Deck: As product description, Section 2
 Supporting structure As product description, Section 2



Preliminary test (stage 1)


Parameter	Criteria				Test result	Compliance			
	Class B _{ROOF(t4)}	Class C _{ROOF(t4)}	Class D _{ROOF(t4)}	Class E _{ROOF(t4)}		Class B _{ROOF(t4)}	Class C _{ROOF(t4)}	Class D _{ROOF(t4)}	Class E _{ROOF(t4)}
Burn time	< 5 min	< 5 min	< 5 min	≥5 min	0 sec	Y	-	-	-
Flame spread distance	< 0,38m	< 0,38m	< 0,38m	No limit	None	Y	-	-	-
Penetration	None	None	None	None	None	Y	-	-	-

Penetration test (stage 2)

Parameter	Criteria				Test results				Compliance			
	Class B _{ROOF(t4)}	Class C _{ROOF(t4)}	Class D _{ROOF(t4)}	Class E _{ROOF(t4)}	Specimen 1	Specimen 2	Specimen 3	Mean*	Class B _{ROOF(t4)}	Class C _{ROOF(t4)}	Class D _{ROOF(t4)}	Class E _{ROOF(t4)}
Penetration time	≥ 60 min	< 60 min > 30 min	≤30 min	≤ 30 min	60 min	60 min	60 min	60 min	Y	-	-	-

* If one or two of the specimens have not failed at one hour, a time of 60 min shall be used in calculating the mean time of penetration

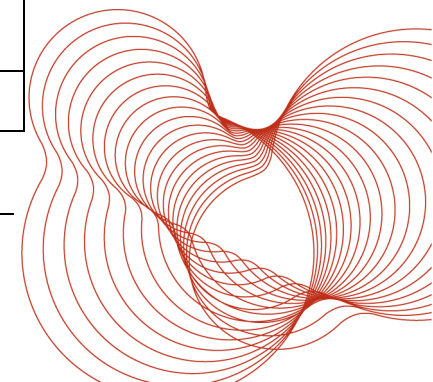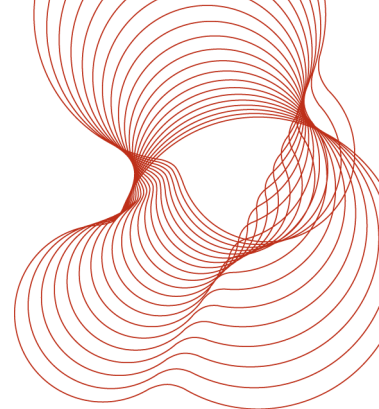

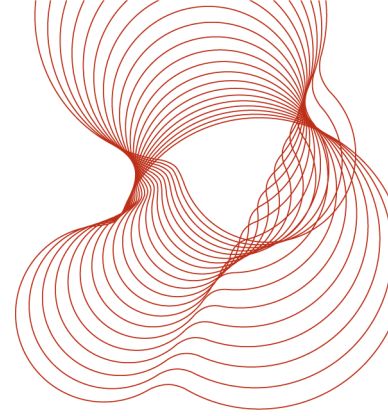

5 Classification and field of application

5.1 Reference of classification

This classification has been carried out in accordance with Table 1 of EN 13501-5:2005

5.2 Classification

The roof in relation to its external fire performance is classified:

B_{ROOF}(t4)

5.3 Field of application

This classification is valid for the following conditions:

Range of pitches

$$0^\circ \leq \text{pitch} \leq 10^\circ$$

Deck and supporting structure

The classification is valid only for the deck and supporting structure tested.

6 Limitations

This classification document does not represent type approval or certification of the product.

The specification and interpretation of fire test methods are the subject of ongoing development and refinement. Changes in associated legislation may also occur. For these reasons, it is recommended that the relevance of test and classification reports over five years old should be considered by the user. The laboratory that issued the report will be able to offer, on behalf of the legal owner, a review of the procedures adopted for a particular test or classification to ensure that they are consistent with current practices, and if required may endorse the report.

7 Reference

BS EN 13501-5:2005 incorporating corrigendum no.1, British Standards Institution, London.

=====REPORT ENDS=====